
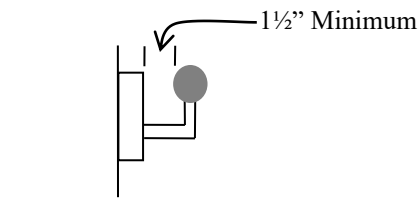


Minimum of 36" Guards Required On Raised Platforms (Landings) When Elevated More Than 30". Ladder Type Designs Are Not Acceptable.

Handrails are required on any flight of stairs having four or more risers.


Tread Depth, Riser Height, and Nosing Projections May Not Vary More Than 3/8" In The Entire Run Of The Stair.

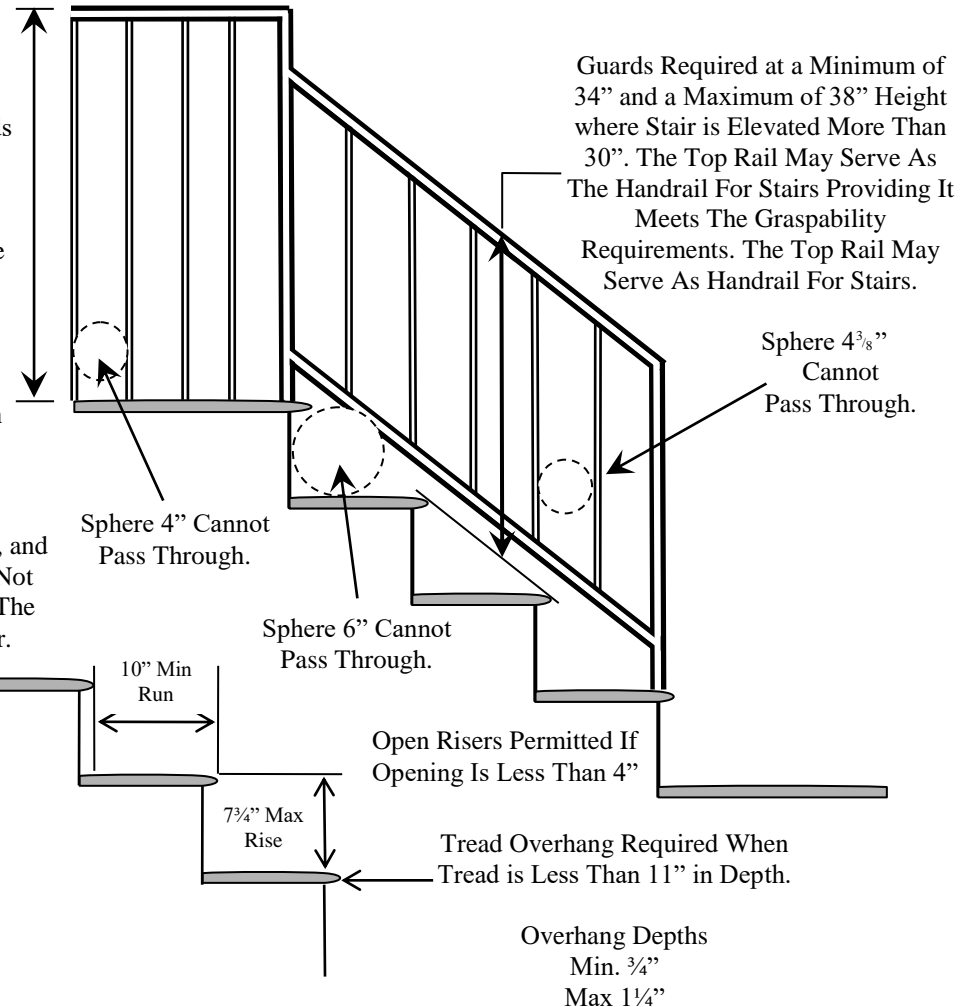

Type I
Circular Handrail
Width 1¼" Min. 2" Max.
Diameter or Provide
Equivalent Graspability.



Type I
Noncircular Handrail
Must Have A Perimeter Of 4"
Min. 6¼" Max With A Max Cross
Section Dimension of 2¼"

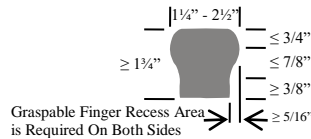

Type II
Handrails With
Perimeter > 6¼"
Edges Shall Have A
Min. Radius of .01"



ROCHESTER, NEW HAMPSHIRE

DEPARTMENT OF
BUILDING AND LICENSING SERVICES
TELEPHONE: 603-332-3508

Website: www.rochesternh.gov

Online Portal: <https://rochesternh.viewpointcloud.com/>

Stairs Handout

Based On 2018 R311.7.8 ICC IRC
For Residential Use Only